

Berakas Power Company Sdn Bhd

RFQ-2026-0709 – Topo Survey for New Walkway & Drainage at Masin 66/11kV Substation Solar Panels Site

BERAKAS POWER COMPANY SDN BHD
BERAKAS POWER STATION, JALAN RIMBA LINK
KG. TERUNJING BARU, BERAKAS BB1514
NEGARA BRUNEI DARUSSALAM

Item	Description	Qty.	Unit	Unit Rate	Amount
1.0	Supply skilled licensed surveyor and support manpower to perform topographical survey of the proposed Substation (photomap attached), details as follows: Topographical Survey by Licensed Land Surveyor within the boundary of BPC Masin 66/11kV Substation at Jalan Mulaut-Limau Manis. The land survey shall locate the boundaries and pick up natural and manmade features within the specified area including but is not limited to buildings, Solar Panels & equipment, fences, bridges, structures, manholes, sump pits, drainage, road signs, electricity poles, transmission towers, utility markers and services, invert level, pavement and roads, ground level contours in 1 meter interval, rivers and streams etc, and thereafter production of topographical survey plans duly signed by a licensed surveyor (1 set transparency) in A1 size together with softcopy in PDF and latest AutoCAD format, with bearings and co-ordinates in terms of Borneo RSO projection.	1	lot	B\$	B\$
TOTAL AMOUNT					B\$

Completion Period: _____ days

Name & Signature

Email

Contact Phone

Company Stamp

Date

Bid closing date **12 August 2026** upload PDF file at [Request For Quotation – BPC E-Procurement](#)

Postal Address: P O Box 266, Gadong BE 3978, Negara Brunei Darussalam

Office Address: Berakas Power Station, Jalan. Rimba Link, Kg Terunjing Baru, Berakas BB1514, Negara Brunei Darussalam

Tel: +673-2-394 461 **Fax:** + 673-2-393360

PHOTOMAP


Masin 66/11kV Substation

Coordinates 4°49'10.2"N 114°50'29.0"E



SCHEDULE OF OPTIONAL RATES

ITEM	DESCRIPTION	RATE BND	DAY RATE BND
1	Topographical Survey by Licensed Land Surveyor for areas outside of the substation including other land areas needed (on Hourly & Day Rates)		
2	Topographical Survey works by Licensed Land Surveyor & outside of the substation including other land areas needed on area basis (Metre²or M²)		

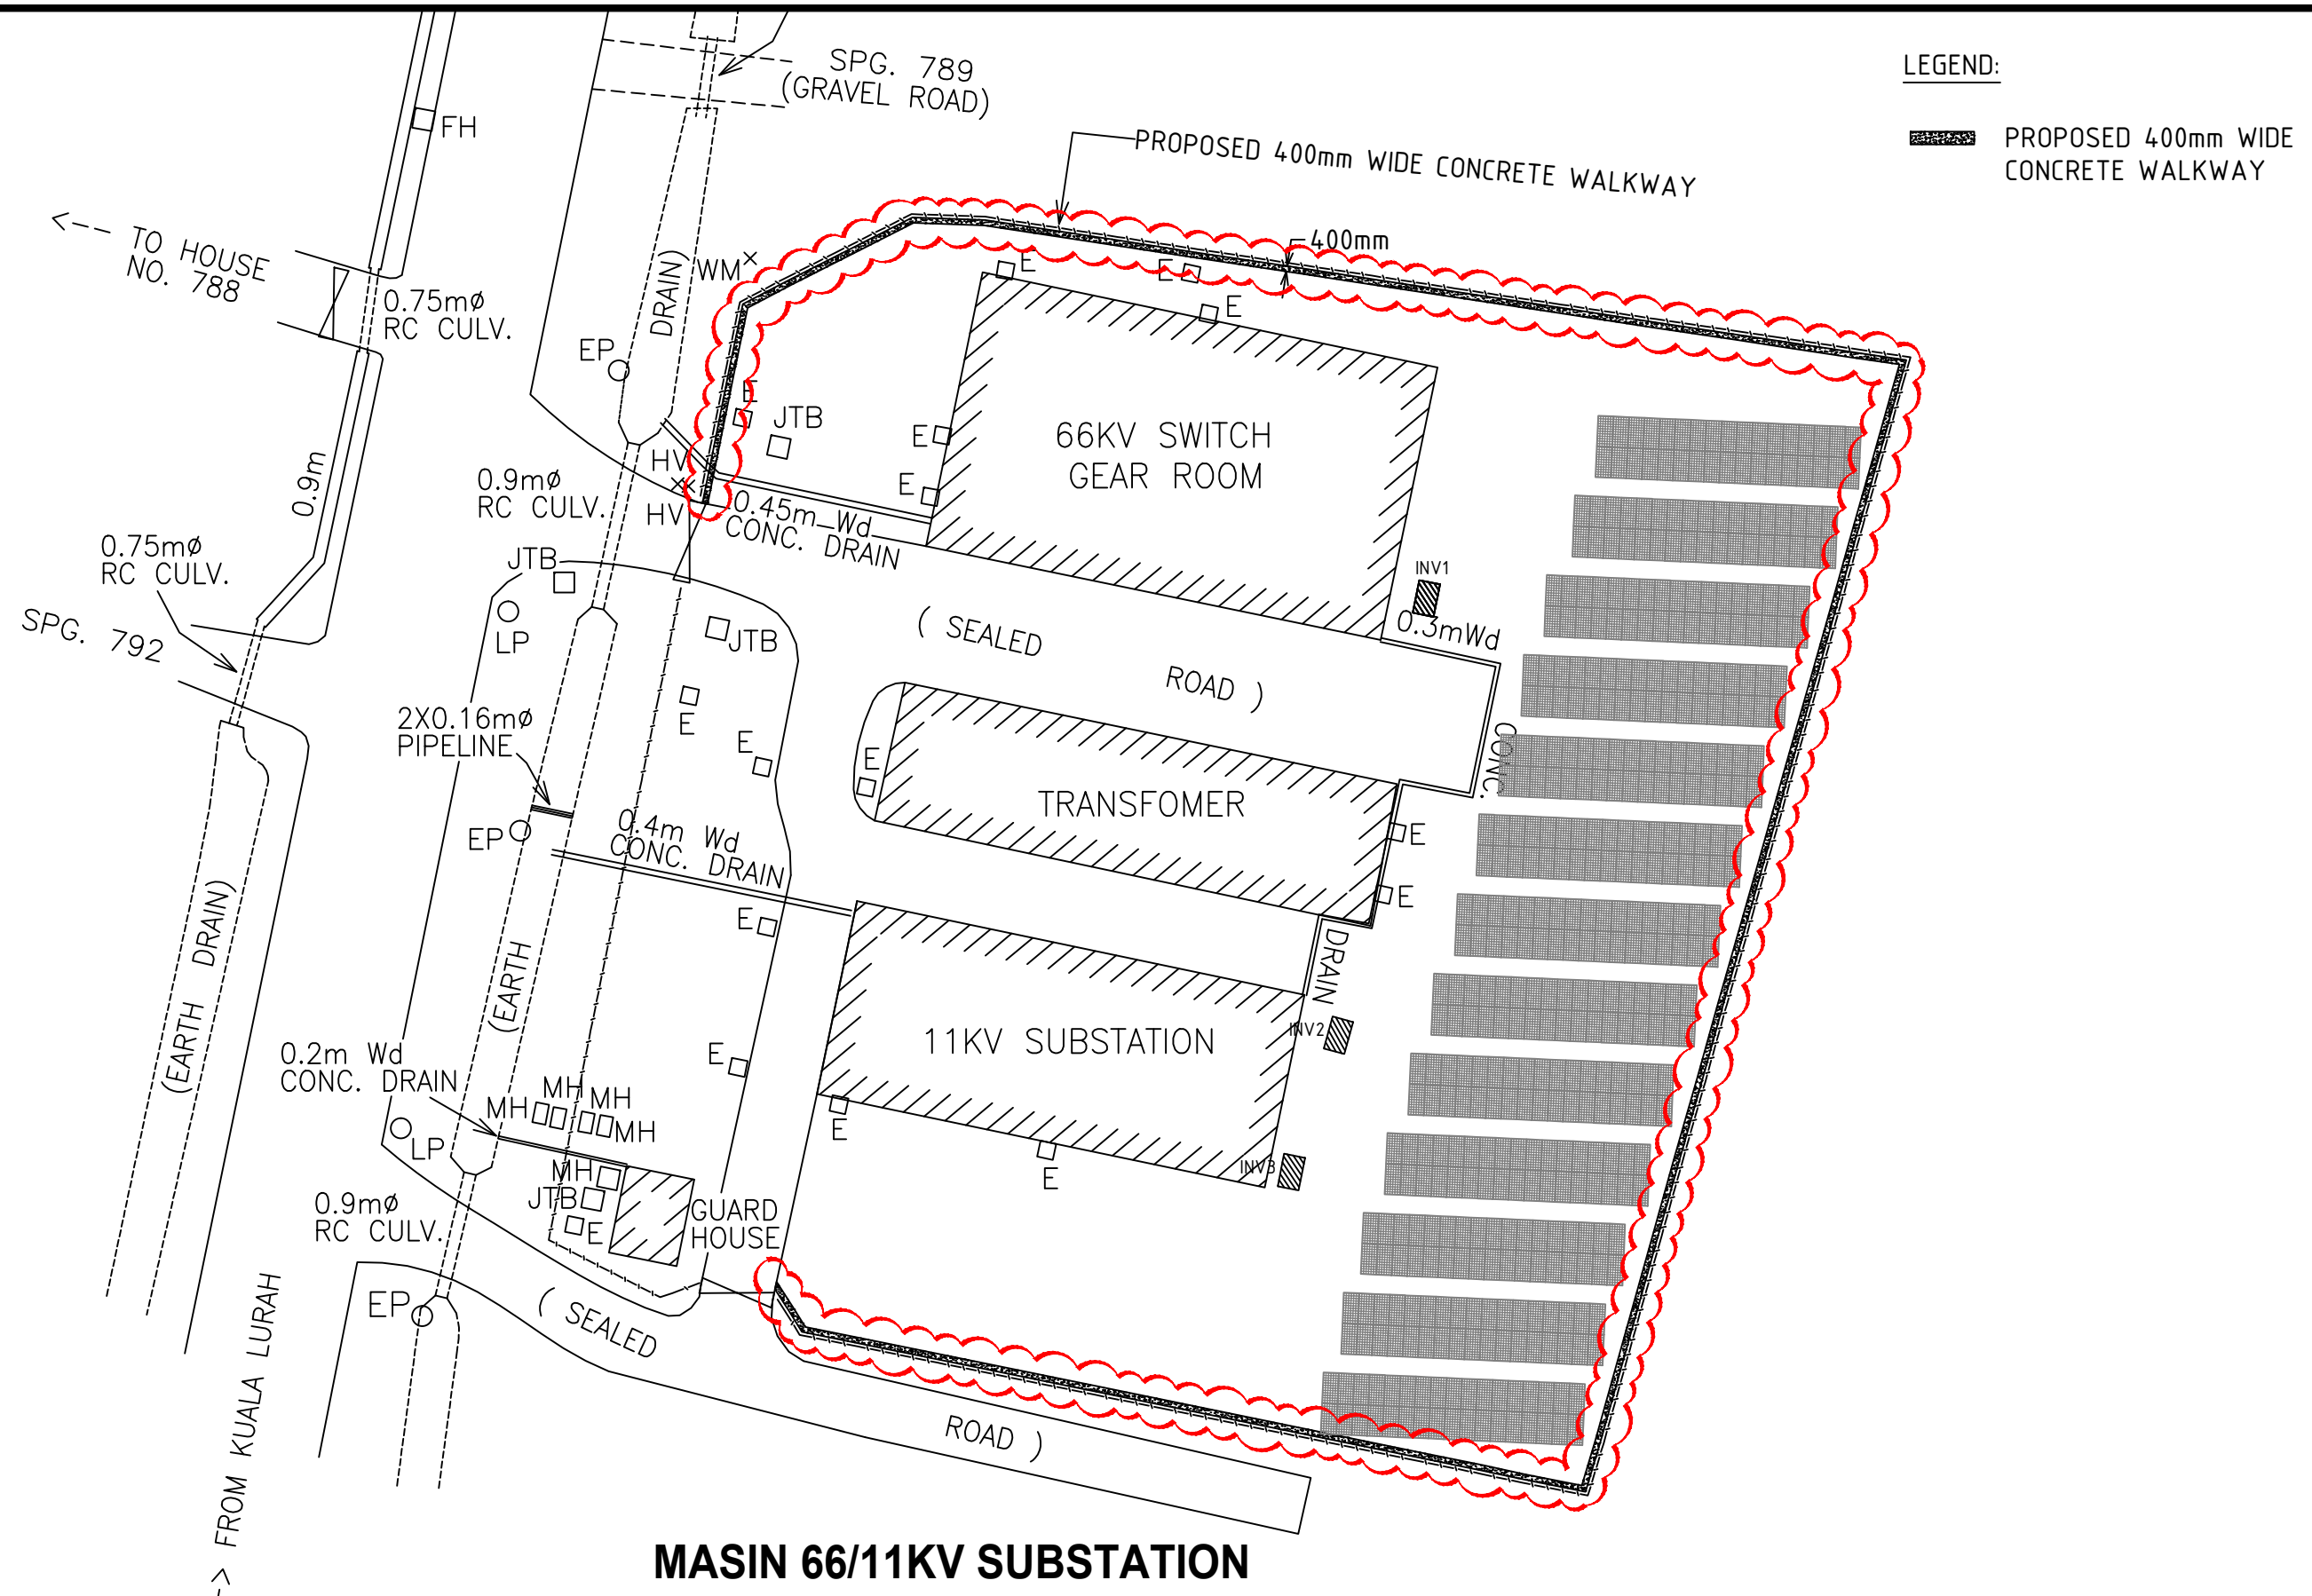

LEGEND:

PROPOSED 400mm WIDE CONCRETE WALKWAY

MASIN 66/11KV SUBSTATION

GENERAL NOTES							BPC شركة براكاس BERAKAS POWER COMPANY SDN BHD Providing Power and Expertise to Serve You DRAWING NO.: MAS-01-12 002-CM DRAWING TITLE: PROPOSED CONCRETE WALKWAY AT MASIN 66/11kv SUBSTATION DATE: 24/07/26 REV: 0 SCALE N.T.S SHEET NO: 01 of 01
	0	PROPOSED 400mm CONCRETE WALKWAY	24/07/26	D.T.Z.	P.W.	C.P.	
REV		DESCRIPTION	DATE	DRAWN	CHECKED	APPR'D	